


NOTES:

1. 95% MIN. COMPACTED UNTREATED BASE COURSE (3/4" MINUS) SHALL BE PLACED UNDER SIDEWALK TO A DEPTH OF NOT LESS THAN 4".
2. ONLY CLASS "A" CONCRETE TO BE USED (5 BAG TYPE V CEMENT).
3. SIDEWALK ACROSS DRIVEWAYS SHALL BE NOT LESS THAN 6" THICK FOR ALL SIDEWALK TYPES, AND HAVE A MIN. OF 6" THICK ROAD BASE FOUNDATION. FIBER EXPANSION JOINTS SHALL BE PLACED AT BOTH ENDS OF DRIVEWAYS. IMPREGNATED FIBER EXPANSION JOINTS REQUIRED BETWEEN DRIVEWAY AND SIDEWALK.

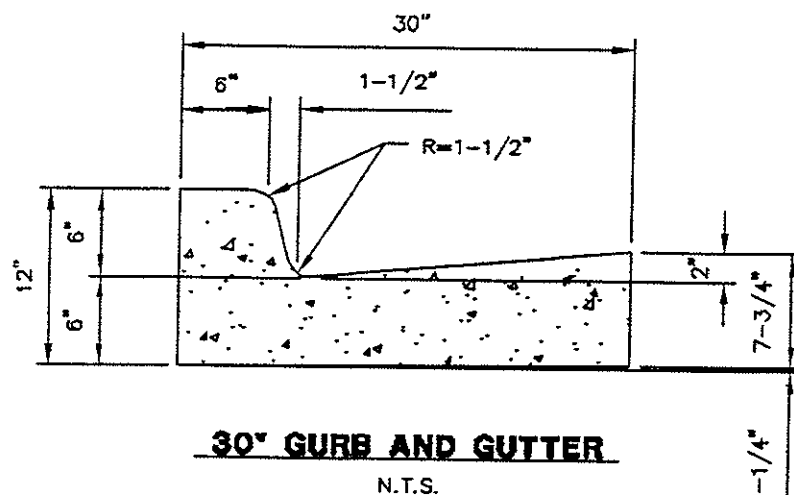

SIDEWALK	ROAD TYPE				
	LOCAL	COLLECTOR	MAJOR COLLECTOR	ARTERIAL	MAJOR ARTERIAL
WIDTH	4'	5'	5'	5'	6'
SCORE AND SPACING	4'	5'	5'	5'	6'
EXPANSION JOINT SPACING	20'	20'	20'	20'	24'